


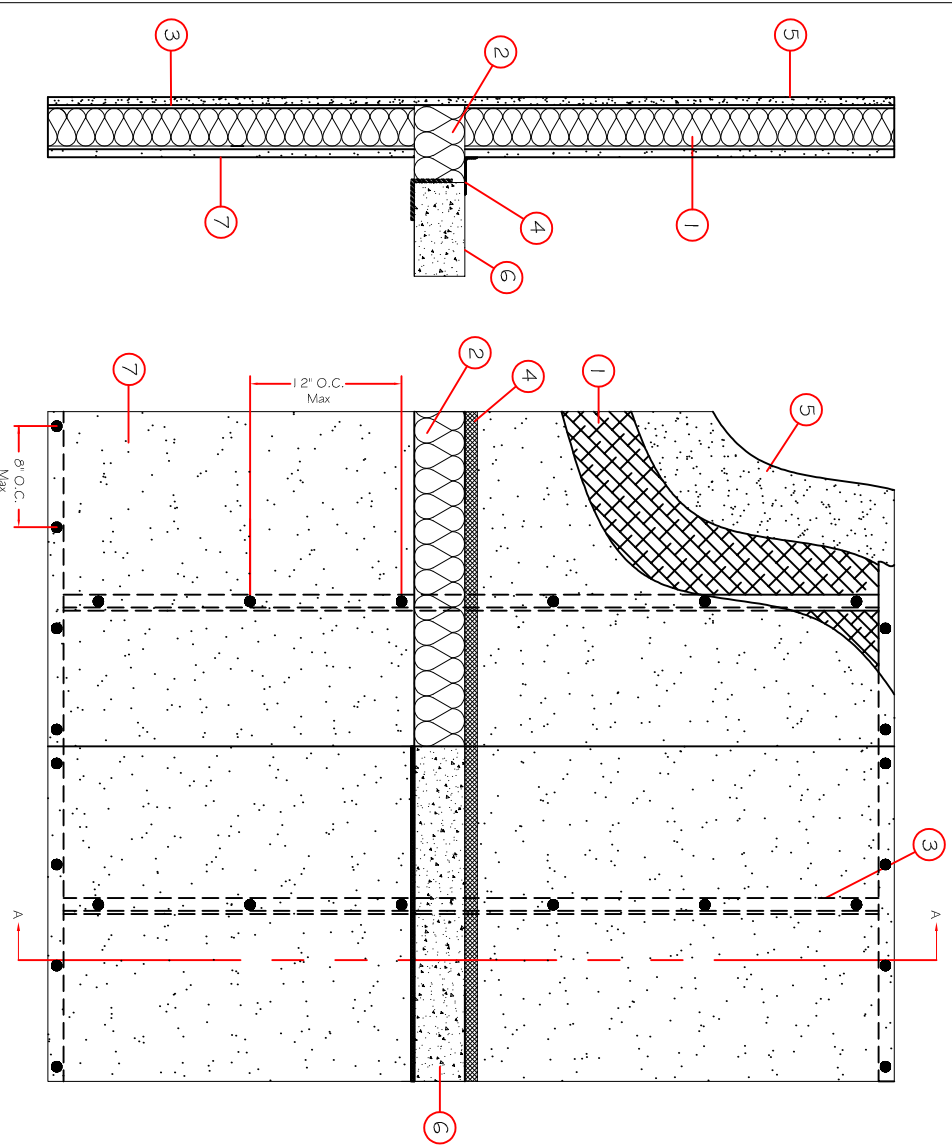

Item Number	Description
1	3 ¹ / ₂ " Thick Owens Corning™ Thermafiber® Firespan® 90 mineral wool insulation thick mineral wool batt insulation, unfaced or faced on one side with aluminum foil/scm vapor retarder, supplied in nom 16" or 24" wide batts to accommodate spacing of steel studs. Insulation installed to completely fill all stud cavities of curtain wall above the top of the fill material and below the forming material. Insulation to be friction-fitted between studs with adjoining lengths of batt tightly butted.
2	Owens Corning® Thermafiber® Safing™ Insulation Nom 4 pcf densely mineral wool insulation cut to a min. 4" width and stacked to a thickness which is 25% greater than the width of linear gap between the gypsum sheathing and the edge of the concrete floor to attain a min 20% compression in the thickness direction. The forming material is compressed and inserted cut-edge-first into linear gap between edge of floor slab and sheathing material such that its top surface is flush with the top surface of the floor assembly. Length of batt to be equal to on-center spacing of steel studs such that it is friction-fitted between studs and mounting angles without seams. Additional pieces of mineral wool batt to be stuffed inside the channel of each steel stud throughout the thickness of the forming material.
3	20 ga. galvanized C-shaped Studs 3 ¹ / ₂ " to 6" wide by 1 ¹ / ₂ " deep with ⁵ / ₁₆ " wide stiffening flanges. Studs spaced max 24" O.C. and welded, bolted or screwed to mounting angles at each floor level. Interior face of studs to be max 2 ¹ / ₂ " from edge of floor assembly. When cementitious backer units are used for exterior sheathing, max stud spacing is 16" O.C. Interior face of studs to be max 2 ¹ / ₂ " from edge of floor assembly.
4	Approved Smoke Sealant spray-applied Min. ¹ / ₂ " thickness over the top of forming material and lapping ¹ / ₂ " onto the top surface of the floor and onto the gypsum sheathing and steel studs. SpecSeal AS200 Elastomeric Spray, SpecSeal Safing Spray or SpecSeal Fast Track Spray
5	Gypsum Board one layer of nom ⁵ / ₈ " thick, 48" wide gypsum sheathing installed to cover entire exterior surface of wall. Sheathing applied with joints centered over studs and secured to steel studs with min 1" long bugle head steel screws spaced max 8" O.C. along the edges and max 12" O.C. in the field of each sheet.
6	Cementitious Backer Units as an alternate to the gypsum sheathing, nom ¹ / ₂ " or ⁵ / ₈ " thick square-edge boards attached to studs with 1 ¹ / ₄ " long corrosion resistant self-tapping water-head steel screws spaced 6" O.C. Joints covered with glass fiber mesh tape.
7	Floor Assembly - Min 4 ¹ / ₂ " thick reinforced lightweight or normal weight (100-150 pcf) structural concrete. Perimeter of floor assembly to be provided with min 3" X 3" x ¹ / ₄ " thick cast-in-place structural steel angle for weld-attachment of mounting angles

Cross Section View A-A

Elevation View

CONFIDENTIAL AND PROPRIETARY INFORMATION OF THERMAFIBER INC.

THESE DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF THERMAFIBER AND CONTAIN SENSITIVE, PRIVILEGED, OR CONFIDENTIAL INFORMATION WHICH MAY BE USED ONLY FOR ITS BENEFIT. THE DISCLOSURE OF THESE DRAWINGS TO UNAUTHORIZED PERSONS IS STRICTLY PROHIBITED. THIS DOCUMENT AND ALL COPIES MUST BE RETAINED IN STRICTLY CONFIDENTIAL MANNER AND ALL THERMAFIBER PRODUCTS ARE INSTALLED AS SHOWN.

© COPYRIGHT THERMAFIBER INC. 2014

Reference Design: CW-S-1002

DATE APPV: / /

Drawn By: SPR

Dimensions ± ¹/₃₂"

Angle ±2°

DATE:

DRAWING NUMBER:

CW-S-1002

