



System No. CW-D-1001


December 30, 2022

F Rating — 2 Hr

T Rating — 1/4 Hr

Linear Opening Width - 6 In. Max

Class II Movement Capabilities - 5% Vertical Shear (See Item 3)

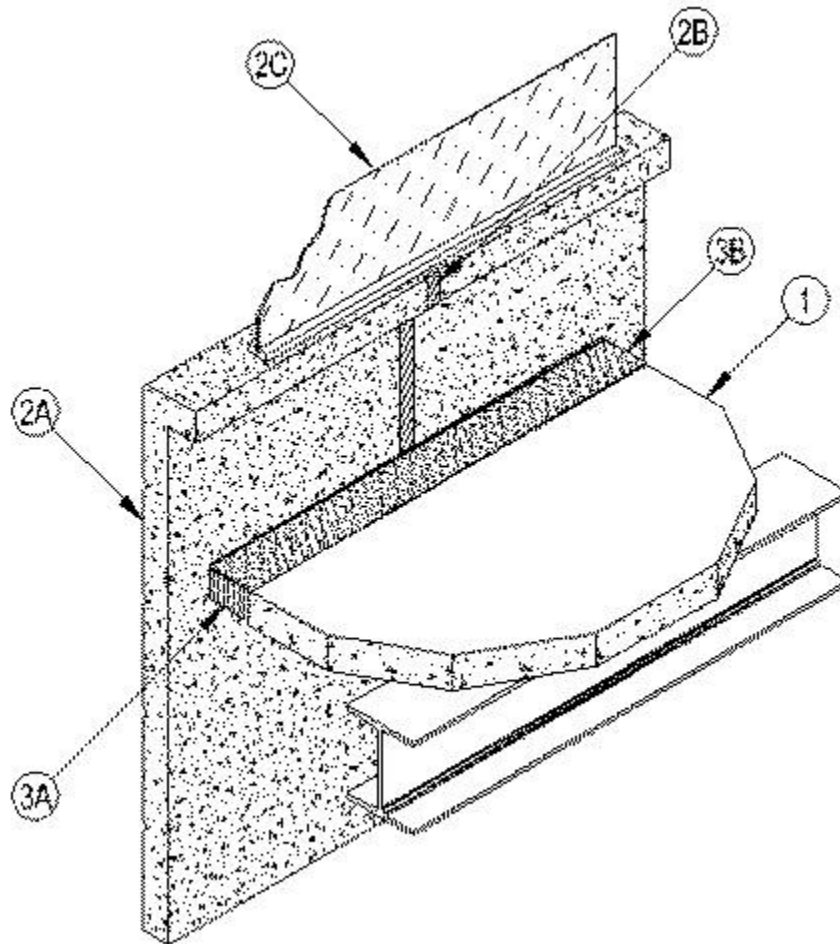

1. Floor Assembly — Min 4-1/2 in. (114 mm) thick steel-reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete. Floor assembly to be supported at perimeter edges by spandrel beams having a Restrained or Unrestrained Beam Rating of 2 hr.

2. Curtain Wall Assembly — The curtain wall assembly shall incorporate the following construction features:



Scan the QR code to request an Engineering Judgment.

THERMAFIBER, INC.

ONE OWENS CORNING PARKWAY
TOLEDO, OH 43659 USA
888-TFIBER1 [834-2371]

www.owenscorning.com/thermafiber

Pub. No. 10028353. Printed in U.S.A. August 2024.

© 2024 Owens Corning. All Rights Reserved. © 2024 Thermafiber, Inc. All Rights Reserved.



A. Spandrel Panels — Min 36 in. (914 mm) high by min 4 in. (102 mm) thick steel-reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) structural concrete spandrel panels. Wall may also consist of min 4 in. (102 mm) thick steel-reinforced lightweight or normal weight concrete tilt-up panels with a min 36 in. (914 mm) vertical separation between window openings. Panels provided with steel dead load anchors welded to steel reinforcing bars embedded in the concrete for attachment to the steel columns and spandrel beams. Panels also provided with steel lateral anchors or braces. The dead load anchors which are located in the linear gap between the concrete floor slab and the spandrel panel or tilt-up panel are to be spaced max 72 in. (1829 mm) OC. The top of the dead load anchor is to be recessed min 1/2 in. (13 mm) from top surface of floor.

B. Joint System — (Not Shown) — Vertical joints between spandrel panels or tilt-up panels to be protected using Joint System Nos. WW-S-0042 or WW-S-0097

C. Framed Window — Metal framed window with nom 1/4 in. (6 mm) thick heat-strengthened glass. Sill of window to be min 6 in. (152 mm) above top of floor.

3. Safing System — Max separation between edge of floor assembly and concrete spandrel or tilt-up panel is 6 in. (152 mm). The safing system is designed to accommodate vertical shear movement of up to 5 percent of its installed width. The safing system shall incorporate the following construction features:

A. Forming Material* — Nom 4 in. (102 mm) thick mineral wool batt safing material to be installed between the concrete spandrel or tilt-up panel and the edge of the concrete floor slab. Safing material to be cut to a min 4-1/2 in. (114 mm) width and stacked to a thickness which is at least 25 percent greater than the width of the linear gap between the concrete spandrel or tilt-up panel and the edge of the concrete floor slab. The safing material is compressed and inserted cut-edge-first into the linear gap such that its top surface is flush with the top surface of the floor assembly. A max of one tightly-butted seam is permitted between dead load anchors. An additional min 1/2 in. (13 mm) thick piece of mineral wool batt safing material to be installed to cover top surface of each dead load anchor.

THERMAFIBER/OWENS CORNING — SAF

B. Fill, Void or Cavity Material* — Min 1/8 in. (3.2 mm) wet thickness (1/16 in. or 1.6 mm dry) of fill material spray-applied over top of forming material and lapping min 1 in. (25 mm) onto the top surface of the concrete floor and onto the concrete spandrel panel or tilt-up panel. When CFS-SP SIL is used, min wet (and dry) thickness of spray is 2 mm.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — CFS-SP SIL Firestop Silicone Joint Spray or CFS-SP WB Firestop Joint Spray



Scan the QR code to request an Engineering Judgment.

THERMAFIBER, INC.

ONE OWENS CORNING PARKWAY
TOLEDO, OH 43659 USA
888-TFIBER1 [834-2371]

www.owenscorning.com/thermafiber

Pub. No. 10028353. Printed in U.S.A. August 2024.

© 2024 Owens Corning. All Rights Reserved. © 2024 Thermafiber, Inc. All Rights Reserved.