


Item Number		Description	Item Number	Description
1	Spandrel Panels Min 36" high by min 4" thick steel-reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m ³) structural concrete spandrel panels. Wall may also consist of min 4" thick steel-reinforced lightweight or normal weight concrete tilt-up panels with a min 36" vertical separation between window openings. Panels provided with steel dead load anchors welded to steel reinforcing bars embedded in the concrete for attachment to the steel columns and spandrel beams. Panels also provided with steel lateral anchors or braces. The dead load anchors which are located in the linear gap between the concrete floor slab and the spandrel panel or tilt-up panel are to be spaced max 72" O.C. The top of the dead load anchor is to be recessed min $\frac{1}{4}$ " from top surface of floor		4	Nom 4" thick mineral wool batt saffing material to be installed between the concrete spandrel or tilt-up panel and the edge of the concrete floor slab. Saffing material to be cut to a min 4 $\frac{1}{2}$ " width and stacked to a thickness which is at least 25% greater than the width of the linear gap between the concrete spandrel or tilt-up panel and the edge of the concrete floor slab. The saffing material is compressed and inserted cut-edge-first into the linear gap such that its top surface is recessed below the top surface of the floor assembly to accommodate the required thickness of fill material. A max of one tightly-buttetd seam is permitted between dead load anchors. An additional min $\frac{1}{4}$ " thick piece of mineral wool batt saffing material to be installed to cover top surface of each dead load anchor. Owens Corning™ Thermafiber® Saffing™ Insulation
	2	Floor Assembly - Mn 4 $\frac{1}{2}$ " thick steel-reinforced lightweight or normal weight (100-150 pcf) structural concrete. Floor assembly to be supported at perimeter edges by spandrel beams having a Restrained or Unrestrained Beam Rating of 2 hour.		
3	Joint System Vertical joints between spandrel panels or tilt-up panels to be protected using Joint System Nos. JW-5-0042		5	Min $\frac{1}{4}$ " thickness of fill material applied over top of forming material flush with the top surface of the concrete floor and lapping onto the concrete spandrel panel or tilt-up panel. HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC - CFS-5 SIL SL Sealant

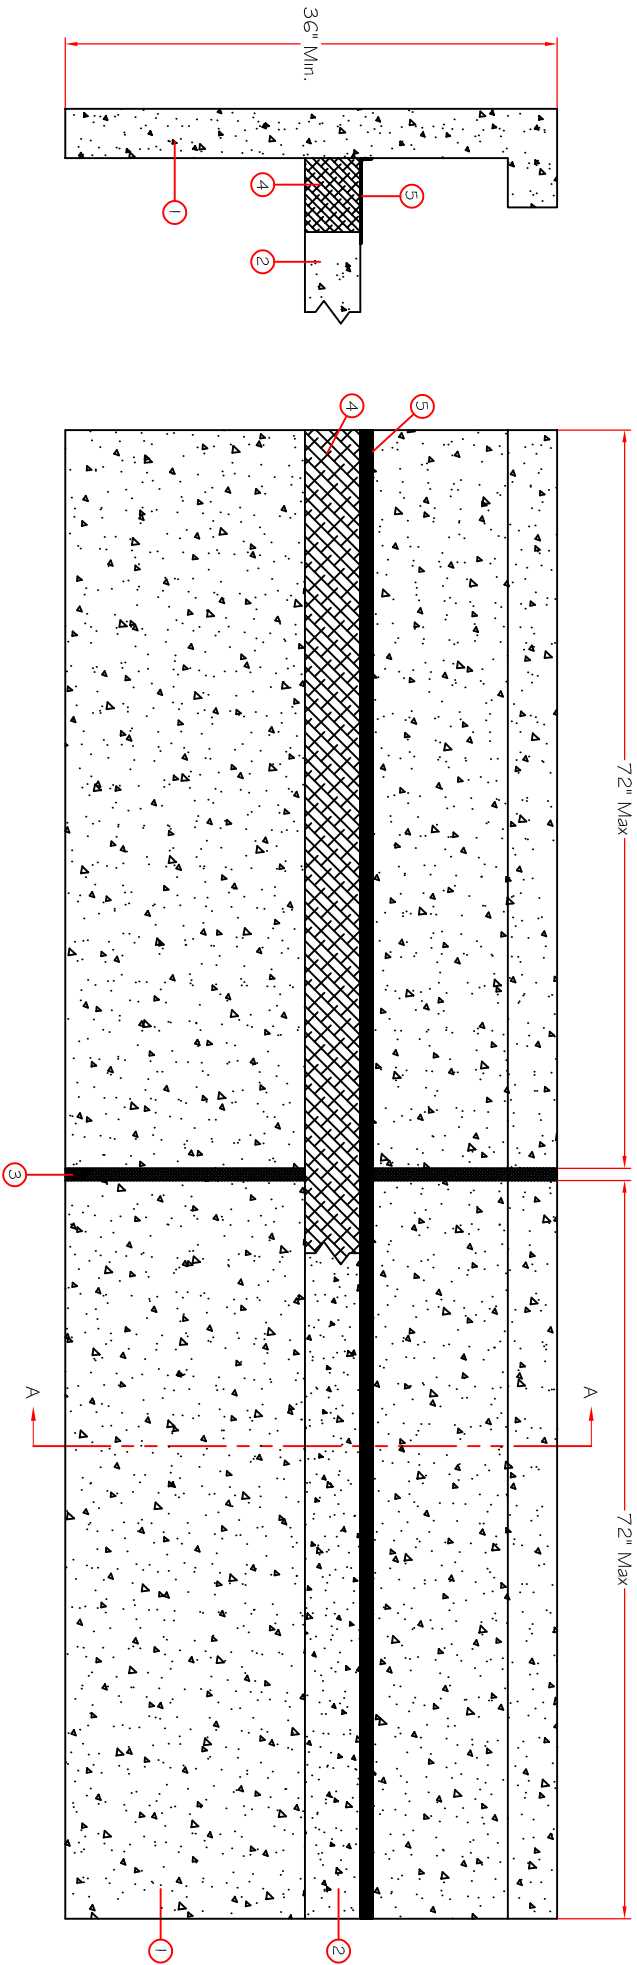

CONFIDENTIAL AND PROPRIETARY INFORMATION OF THERMAFIBER INC.
THESE DRAWINGS ARE THE SOLE AND EXCLUSIVE PROPERTY OF THERMAFIBER
AND CONTAIN SENSITIVE, PRIVILEGED, OR CONFIDENTIAL INFORMATION WHICH
MAY BE USED ONLY FOR ITS BENEFIT. THE DISCLOSURE OF THESE DRAWINGS TO
UNAUTHORIZED PERSONS IS STRICTLY PROHIBITED. THIS DOCUMENT AND ALL
COPIES MUST BE RETAINED IN STRICTLY CONFIDENTIAL MANNER AND ALL
THERMAFIBER PRODUCTS ARE INSTALLED AS SHOWN.
© COPYRIGHT THERMAFIBER INC. 2014

Date	Rev. Num.	Description

Job Name:
Location: City and State:

DRAWING NUMBER:

CW-D-1003

Reference Design: CW-D-1003

DATE APPR: / /

Drawn By: SPR

Dimensions
 $\pm \frac{3}{32}$ "

Angle
 $\pm 2^\circ$

DATE: 07/07/2025



THERMAFIBER